


# DROP MANHOLE

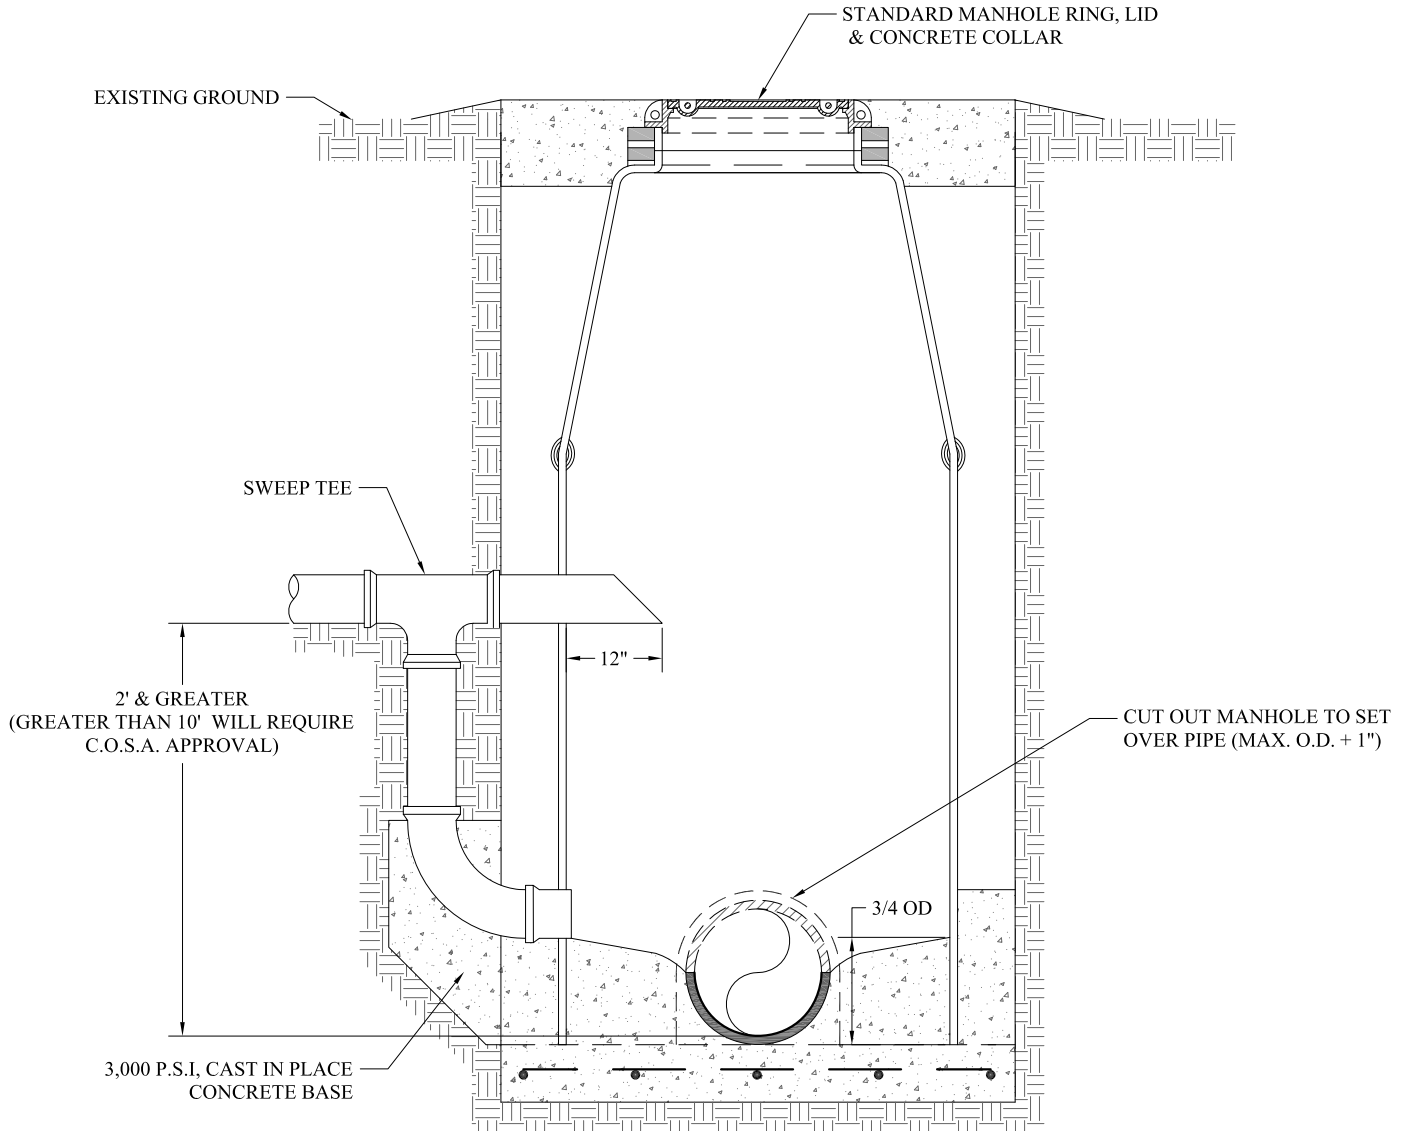

## NOTES

1. CONSTRUCTION OF THE DROP MANHOLE IS IDENTICAL WITH THE STANDARD MANHOLES A, B AND PRECAST CONCRETE MANHOLE IN EVERY RESPECT EXCEPT THE METHOD OF ENTRANCE OF THE SEWAGE FROM THE LATERALS SHALL BE CONSTRUCTED AS SHOWN ABOVE.
2. WHEN ENTERING AN EXISTING MANHOLE WITH A NEW LINE AND THE DIFFERENCE IN ELEVATION OF THE TWO INVERTS EXCEEDS 2' THE METHOD OF ENTRANCE SHALL BE AS ABOVE.
3. BACKFILL SHALL BE COMPACTED IN 6" HORIZONTAL LAYERS MINIMUM DENSITY 95% MODIFIED PROCTOR.

**CITY OF SAN ANGELO**

DROP MANHOLE

JUNE 2016

W-SA-MH-D