


SUBMERSIBLE DUPLEX LIFT STATION - PART 3 OF 4

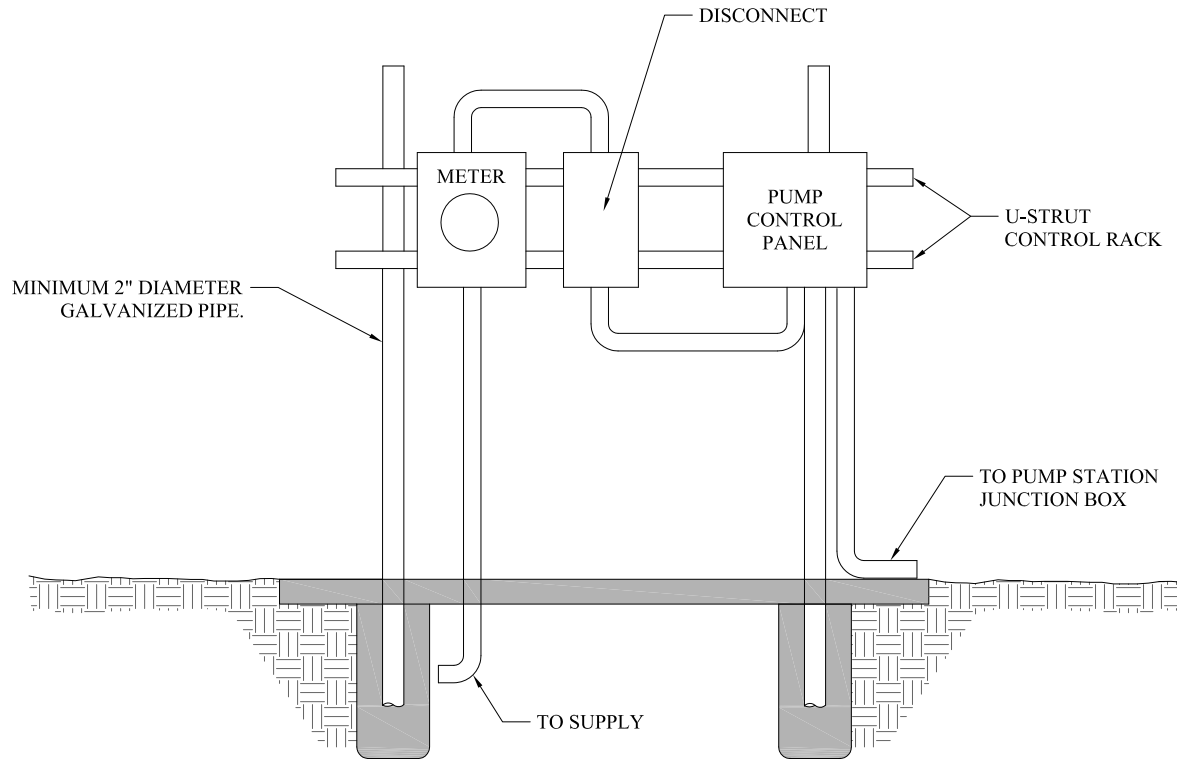

NOTES

1. METER SHALL BE SUPPLIED BY OTHERS.
2. ALL CONDUCTORS AND CONDUIT SHALL BE SIZED IN FULL CONFORMANCE WITH N.E.C. AND ALL APPLICABLE LOCAL CODES.
3. THE DISCONNECT AND PUMP CONTROL PANEL SHALL BE NEMA 4X STAINLESS STEEL.
4. METER, DISCONNECT AND PUMP CONTROL PANEL SHALL BE MOUNTED ON COMMON GALVANIZED U-STRUT CONTROL RACK.

CITY OF SAN ANGELO

SUBMERSIBLE DUPLEX LIFT STATION

PART 3 OF 4

JUNE 2016

W-SA-LS-3