


# 4" SEWER SERVICE LINE

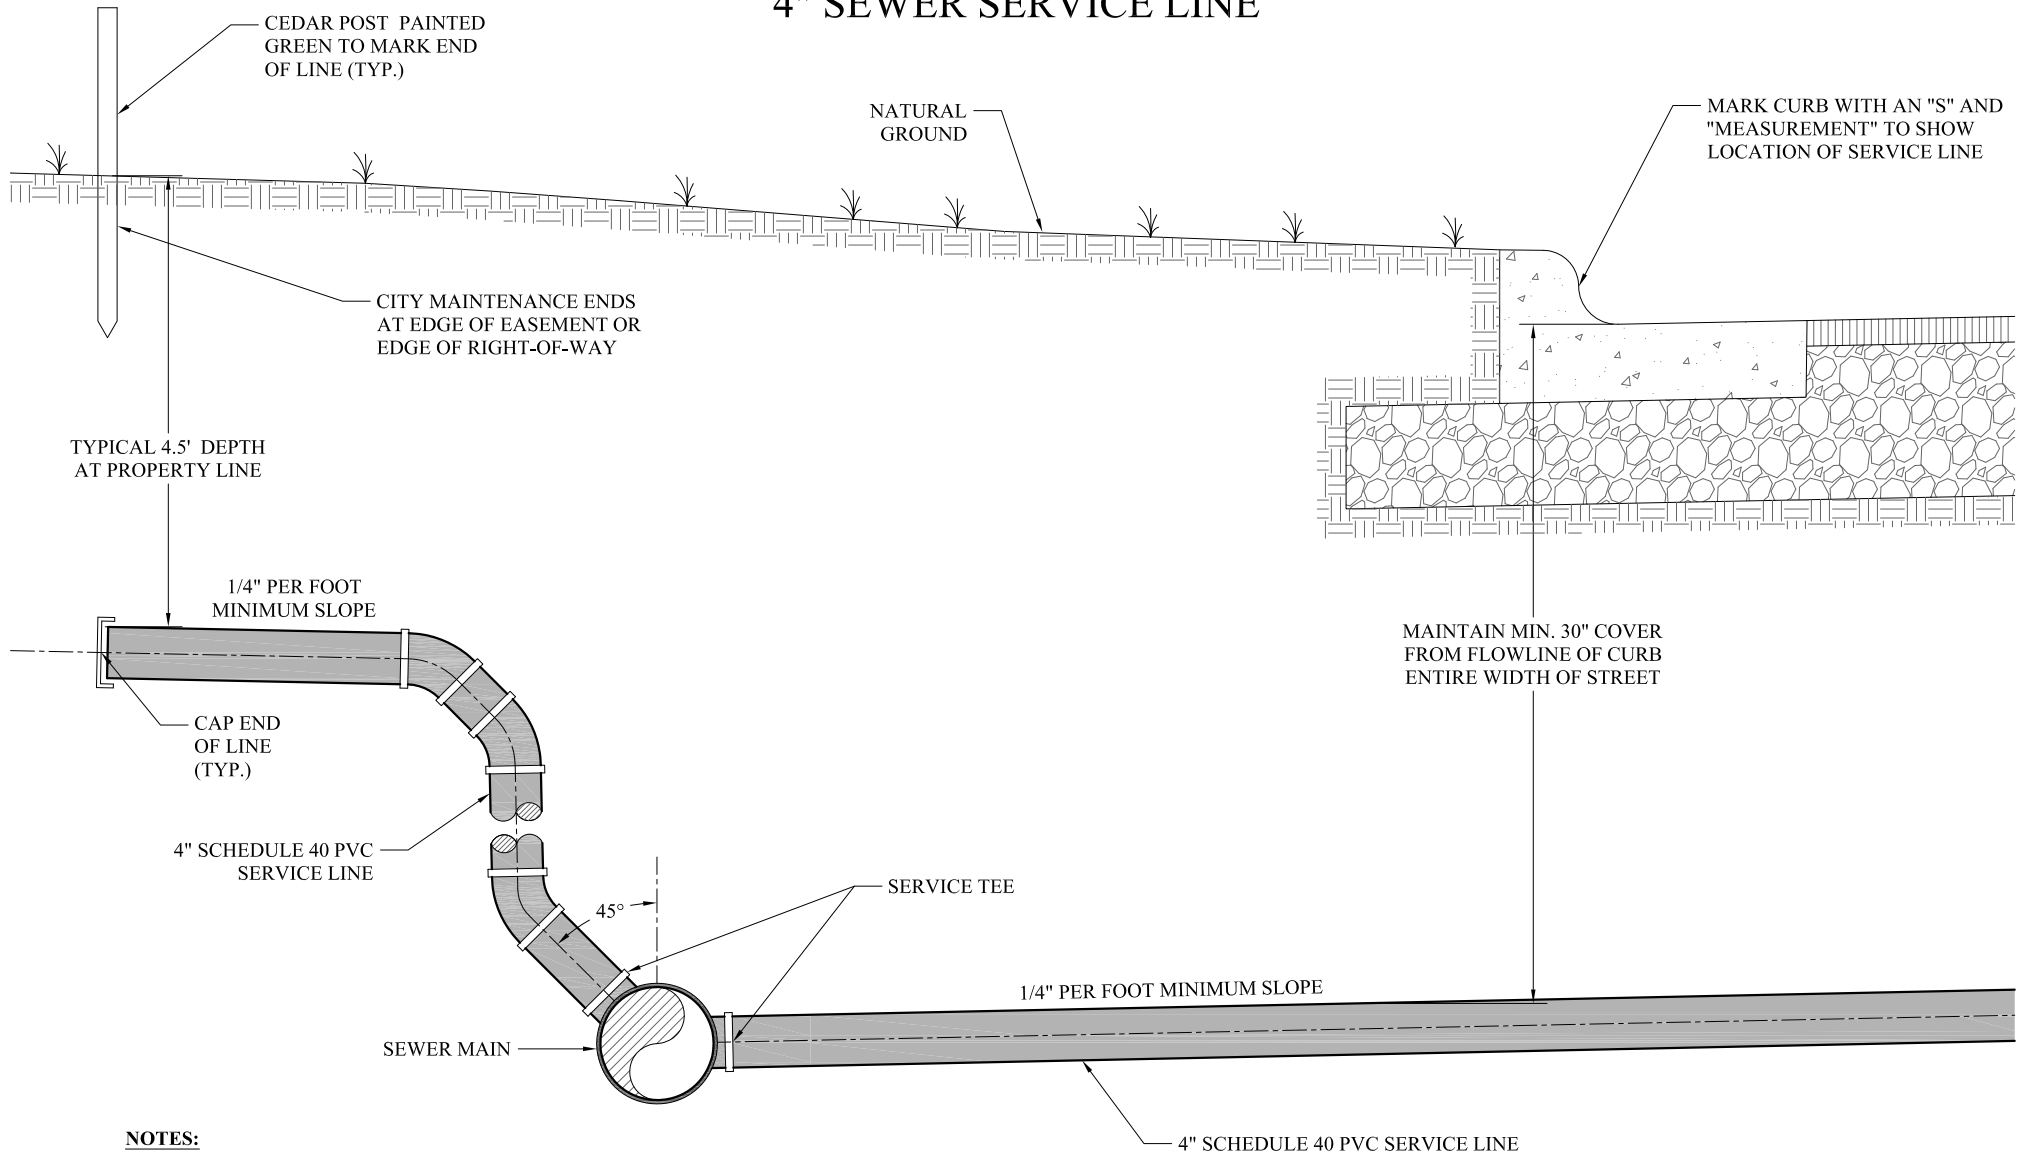

**NOTES:**

1. SEWER SERVICE LINES SHALL BE MINIMUM 4" SCHEDULE 40 PVC WITH GLUED JOINTS.
2. SERVICE LINE PIPE SHALL BE STANDARD 20' JOINTS, UNLESS TOTAL LENGTH OF SERVICE LINE IS LESS THAN 10', OR UNLESS APPROVED OTHERWISE BY THE CITY OF SAN ANGELO.
3. SERVICE LINE BENDS AND WYES SHALL BE SWEPT. MAXIMUM ALLOWABLE BEND FITTINGS SHALL BE 45°.
4. SEWER SERVICES WITH LESS THAN 30" OF COVER FROM THE FLOWLINE OF CURB ON THE SHALLOWER SIDE OF THE STREET SHALL BE INSTALLED WITH A CONCRETE CAP ACROSS THE ENTIRE WIDTH OF STREET.
5. SEWER SERVICE WITH LESS THAN 24" OF COVER FROM THE FLOWLINE OF CURB REQUIRE CITY OF SAN ANGELO APPROVAL.